

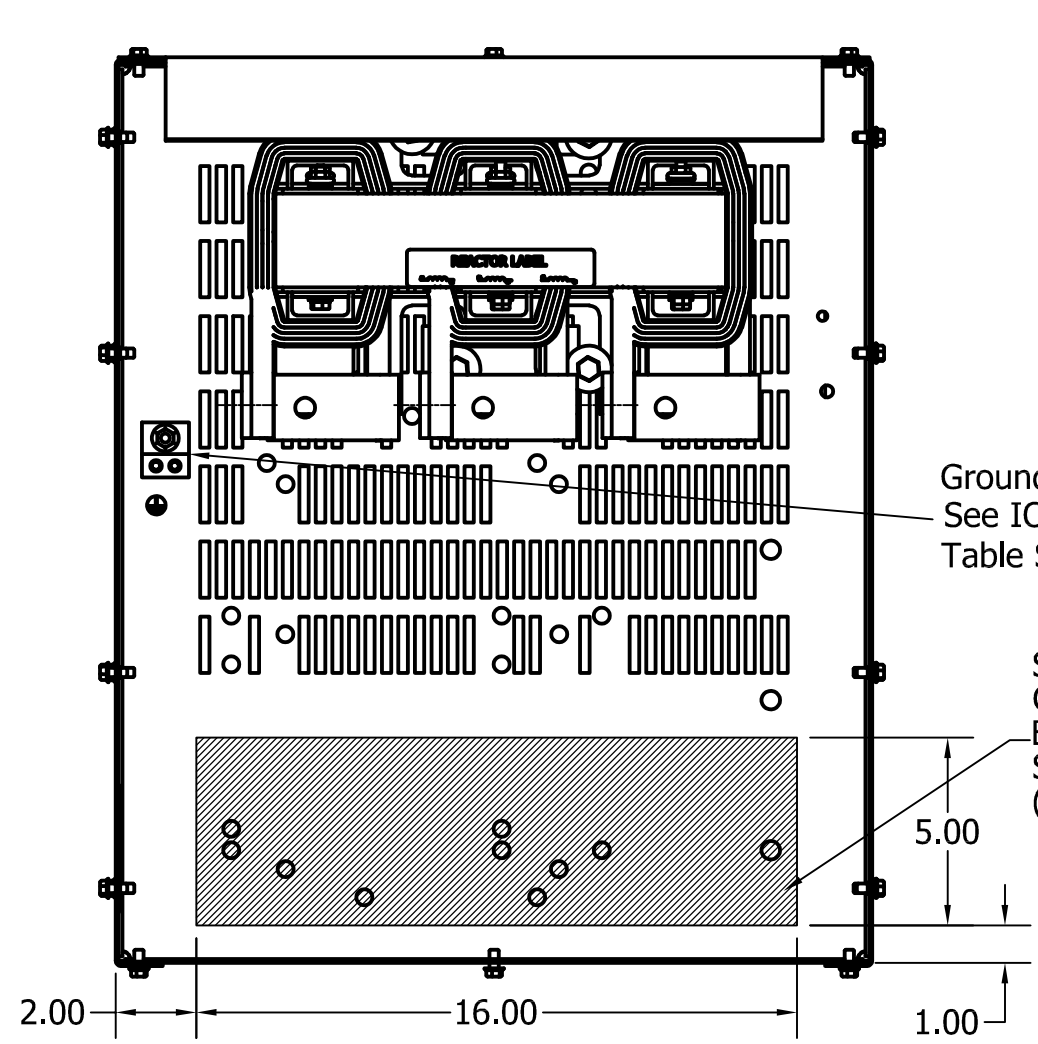
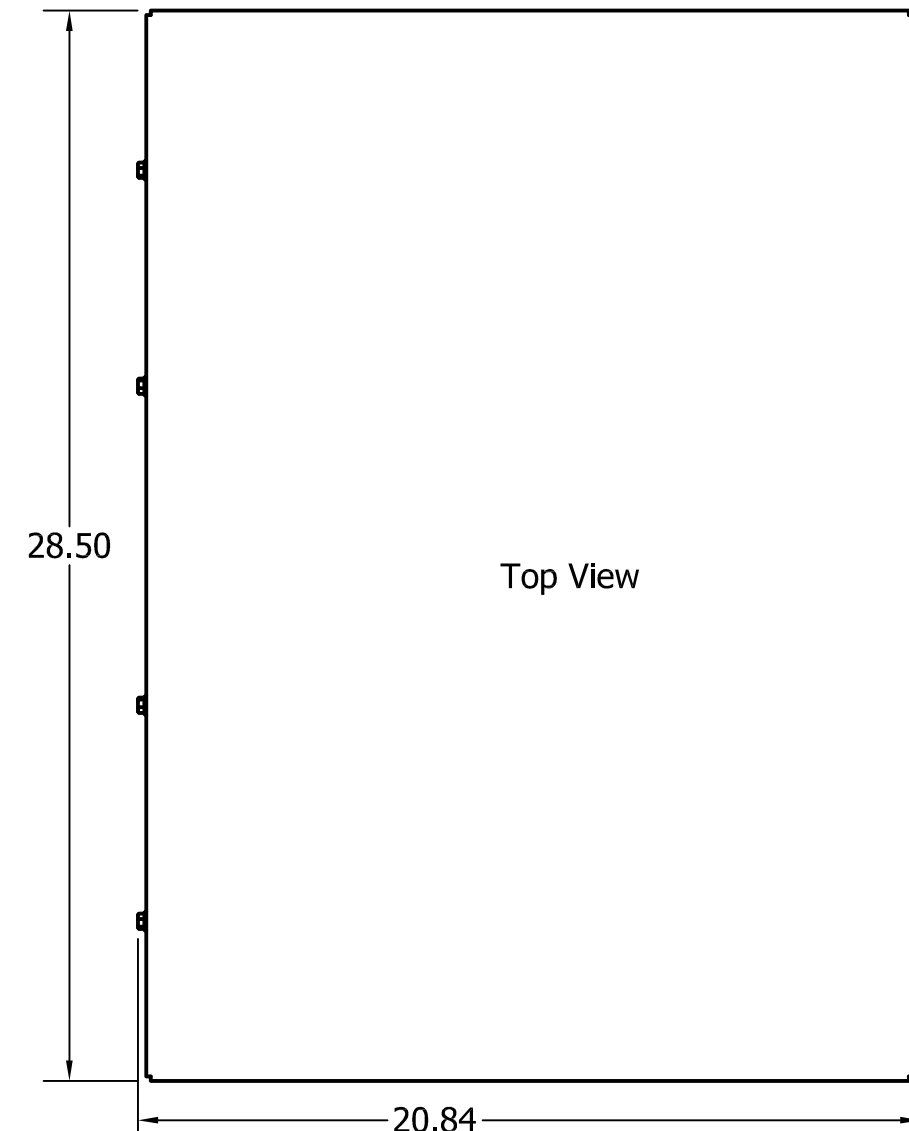
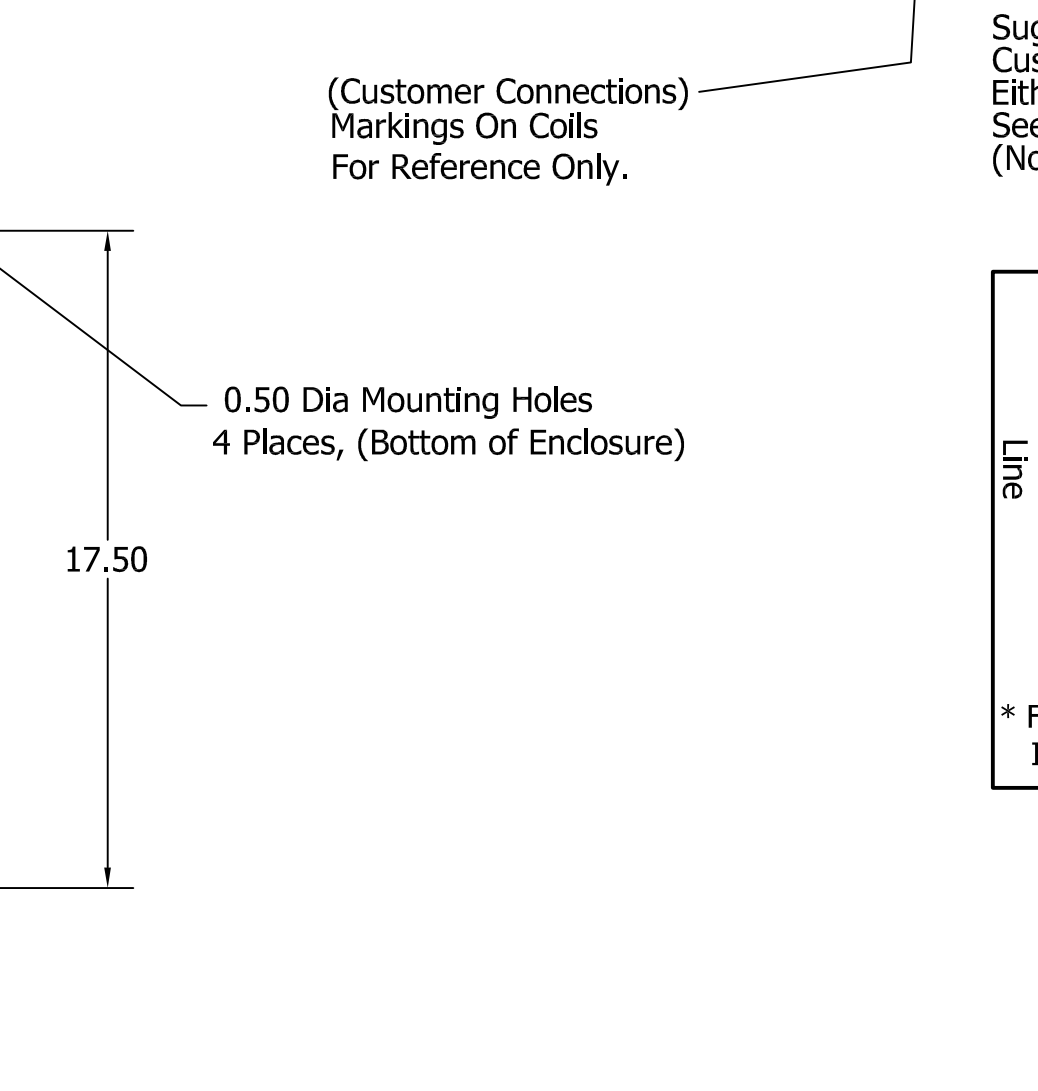
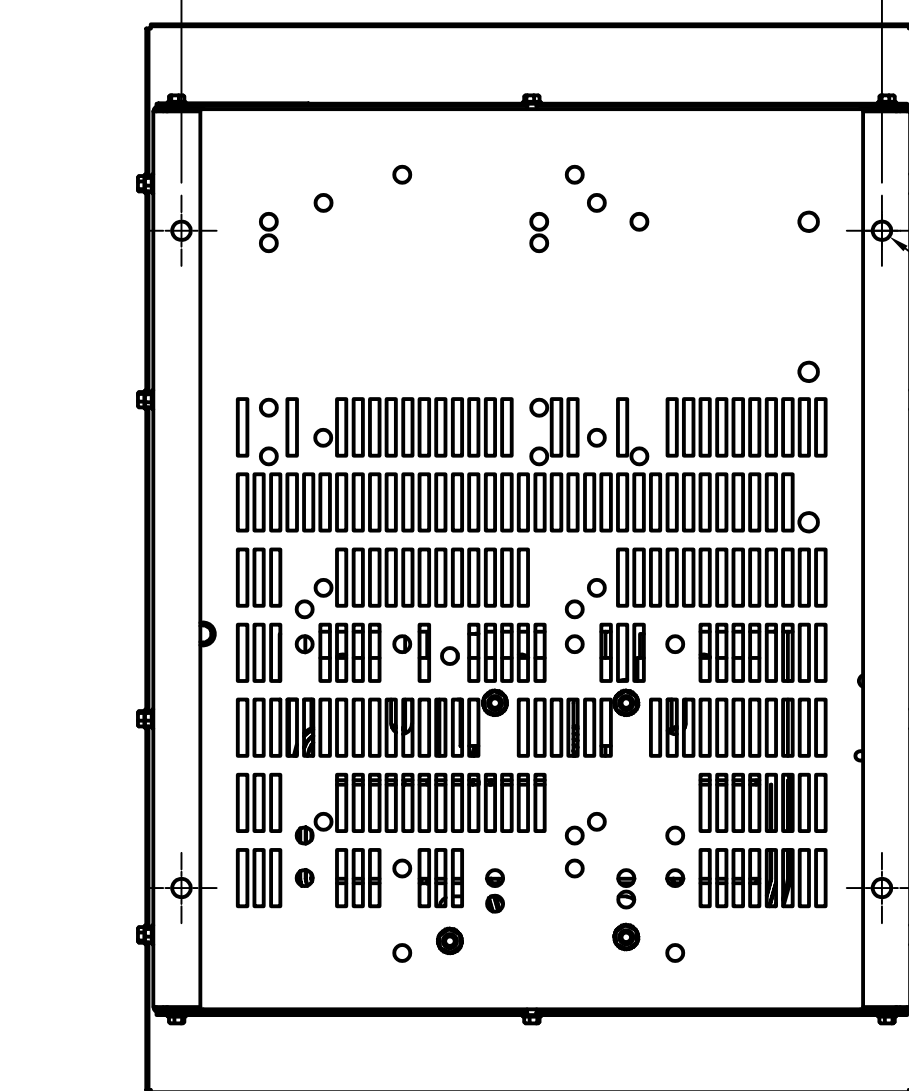
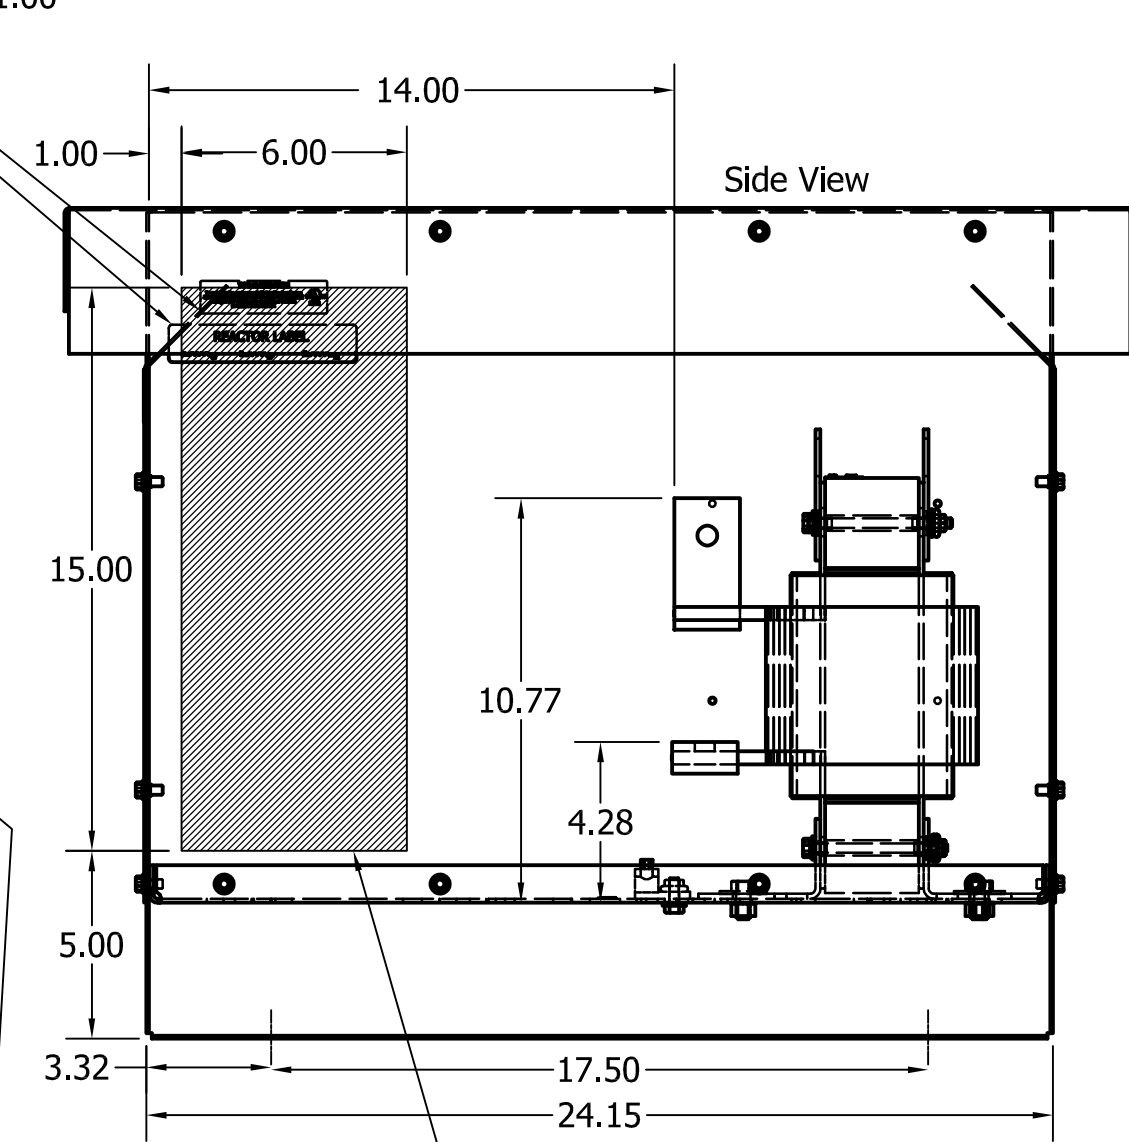


575 Rated Voltage, 600 Max Voltage, High Z, Impedance.								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Available Lug Kit	Terminal Hole Size (Inches)
KDRL48HE3R	350	336	344	138	180	539	SLK13	0.53
KDRL49HE3R	400	382	382	120	180	603	SLK13	0.53

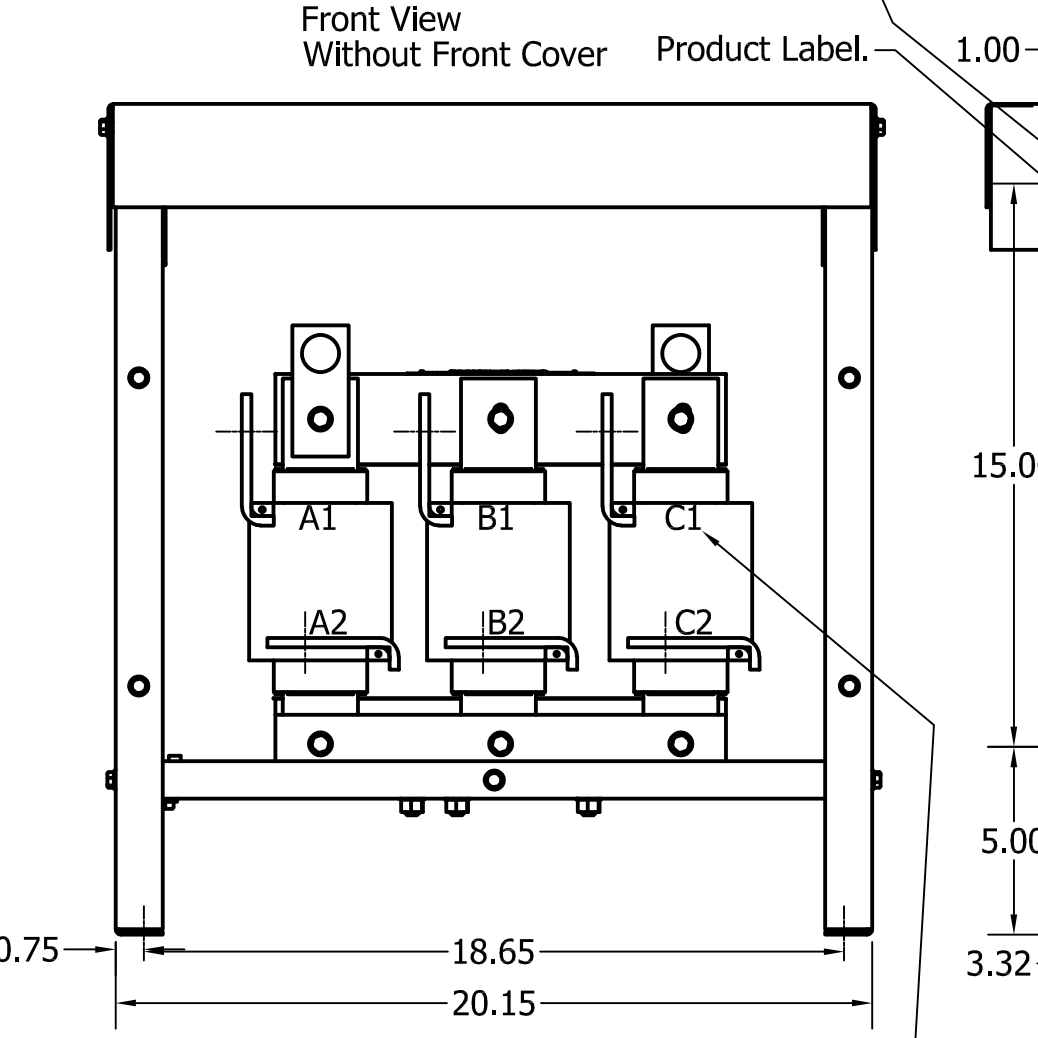

Ground Lug.
See IOM Manual, Part# 30895
Table S2/0, Wire Size And Torque.


Suggested
Customer Wire Entrance
Bottom Of Enclosure.
See Note: 7
(Non Removeable Panel)

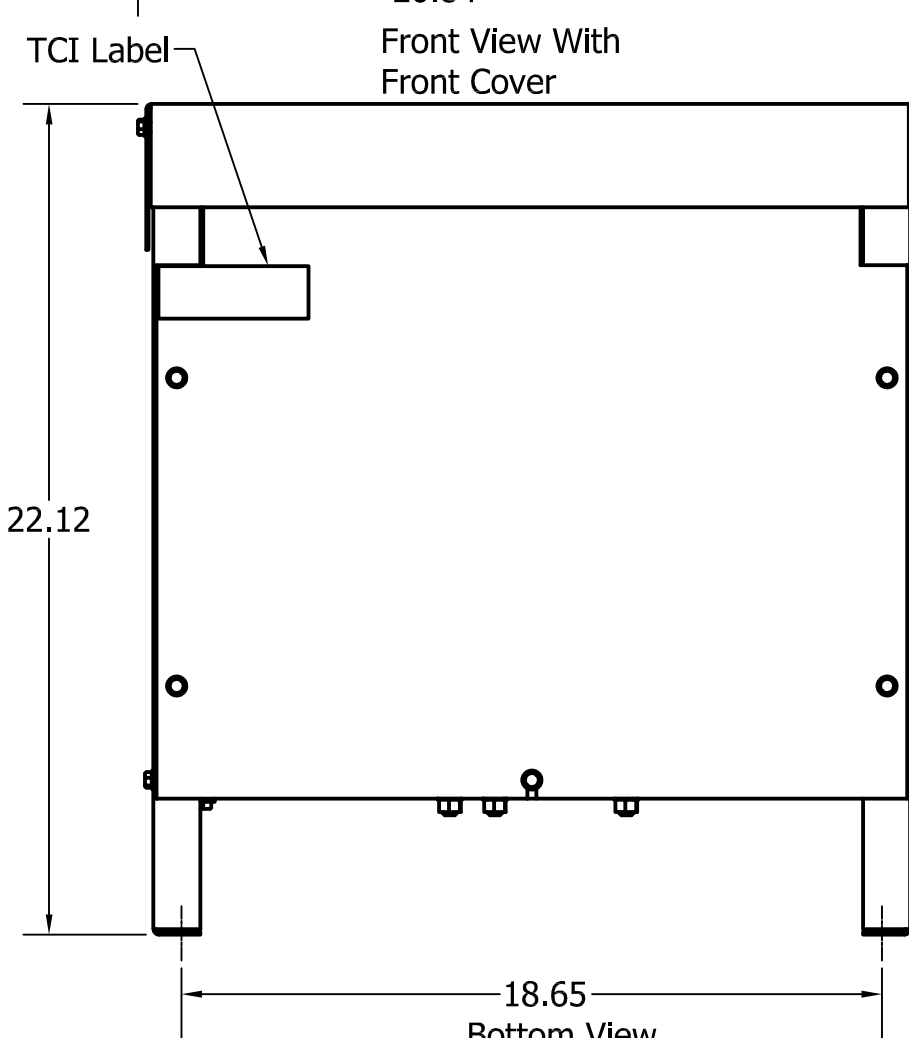

(Customer Connections)
Markings On Coils
For Reference Only.

0.50 Dia Mounting Holes
4 Places, (Bottom of Enclosure)

Suggested
Customer Entrance
Either Side Of Enclosure.
See Note: 7
(Non Removeable Panel)

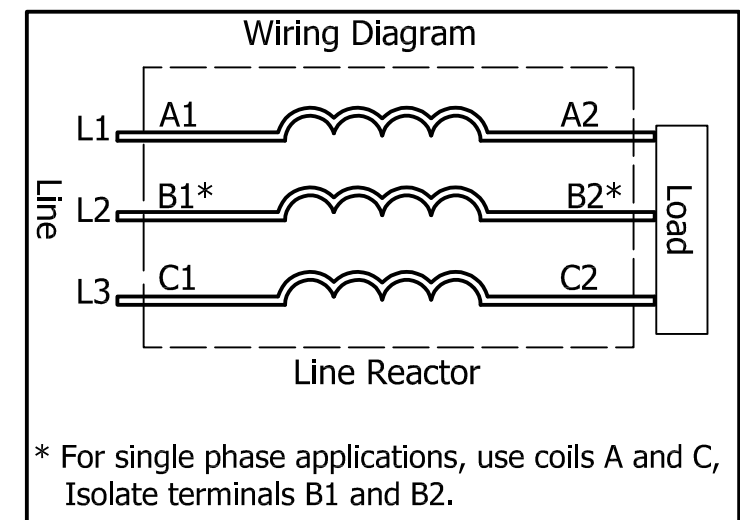

* For single phase applications, use coils A and C,
Isolate terminals B1 and B2.

TCI (800) 824-8282 transcoll.com

TCI, LLC
Germantown, WI, USA
transcoll.com
800-824-8282

KDRUL Drive Reactor
KDR- Motor Amps —
3PH, 50/60Hz, —V Rated, 600V Max, —A Max
40C Amb Max, 155C Rise, RoHS
Manual #30895 LUG KIT #SLK—

UL LISTED CE

DATE CODE A1 A2 B1 B2 C1 C2

- Notes:
1. KDR Lug Kits sold separately. Contact TCI.
 2. For KDRUL Version With Terminal Lugs Attached, See Sheet 4
 3. UL file number: cULus Listed File E116124.
 4. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 5. KDR IOM Manual Part Number 30895
 6. Material(s) Shall be RoHS Compliant
 7. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.

A Combined Drawings		4/25/18	DSW	TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10	W132 N10611 Grant Drive Germantown, WI 53022 KDR L Frame, Copper Bus, Enclosed Type 3R, Reactor Drawing
NO REVISION		DATE	BY	FRACTIONAL ± 1/16	
				ANGULAR ± 1°	DRN BY: DSW SCALE: 1/5 DATE: 4/25/18 APPRV: [Signature] 107622DG SHT 3 OF 10