





480 Rated Voltage, 600 Max Voltage, Low Z, Impedance.								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Available Lug Kit	Terminal Hole Size (Inches)
KDRS1L	700	840	840	26	158	872	SLK16	0.53

575 Rated Voltage, 600 Max Voltage, Low Z, Impedance.								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Available Lug Kit	Terminal Hole Size (Inches)
KDRS41L	800	768	768	29.9	275	955	SLK16	0.53

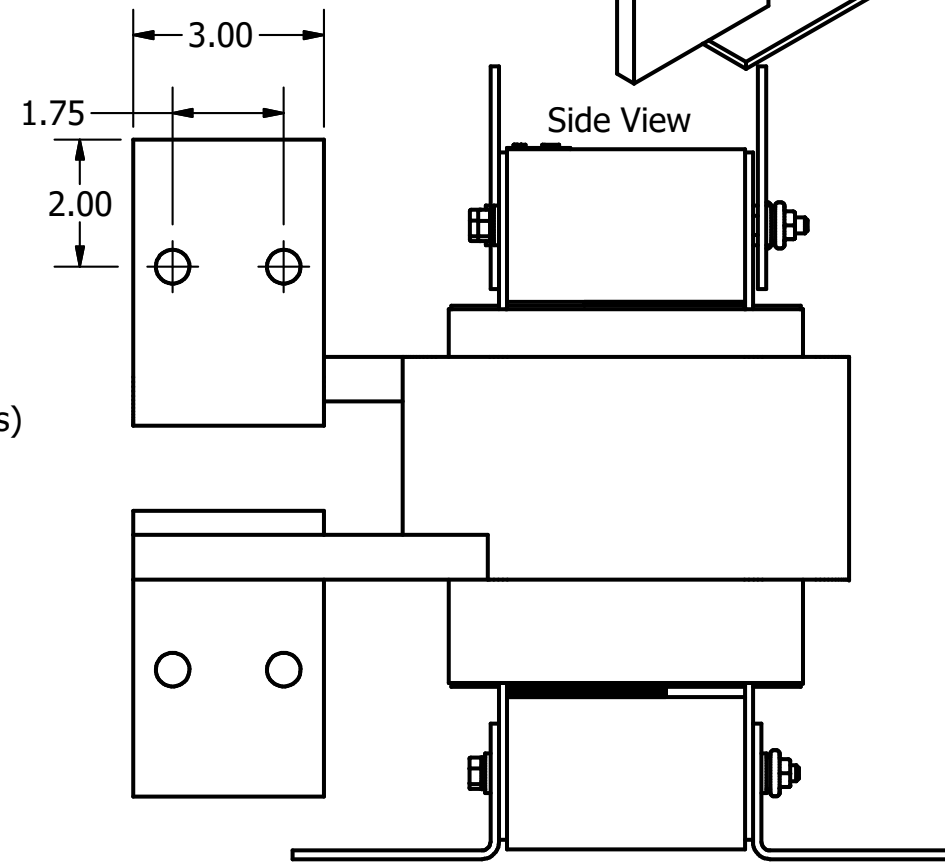

(Customer Connections) Markings On Coils For Reference Only.

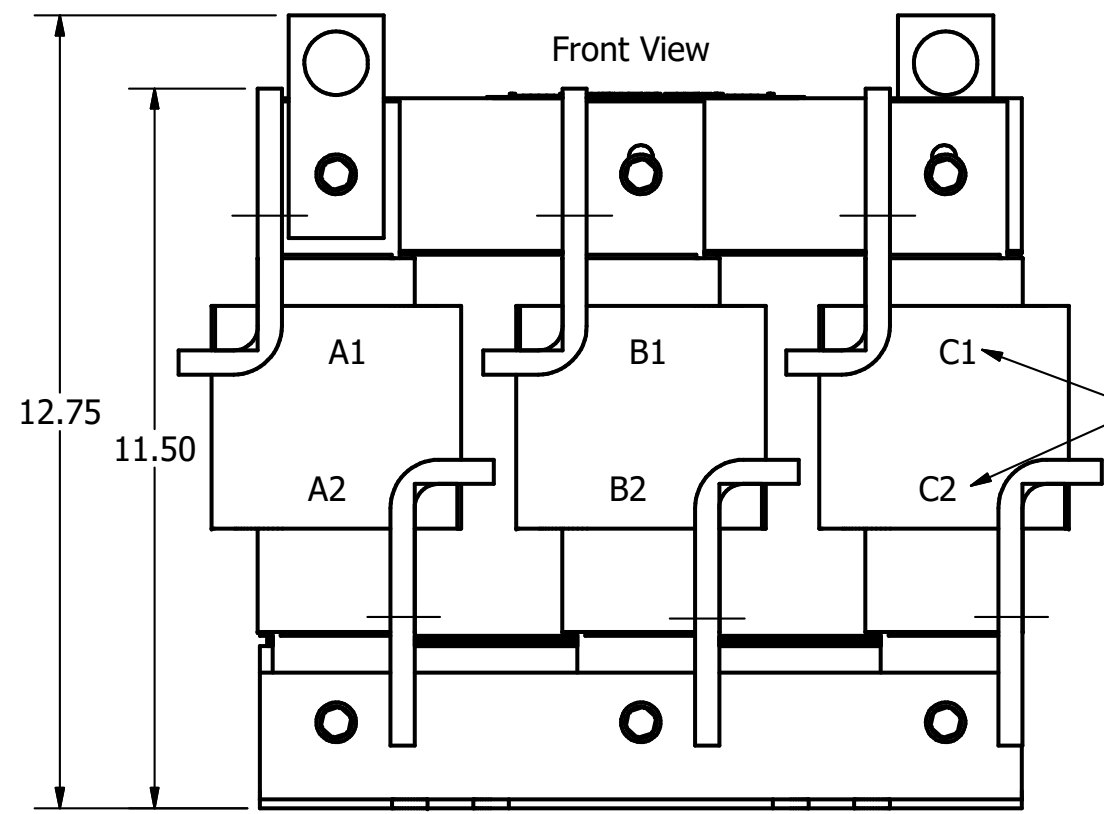

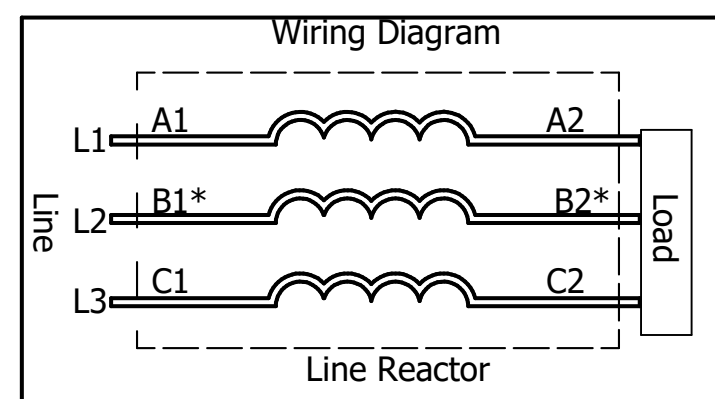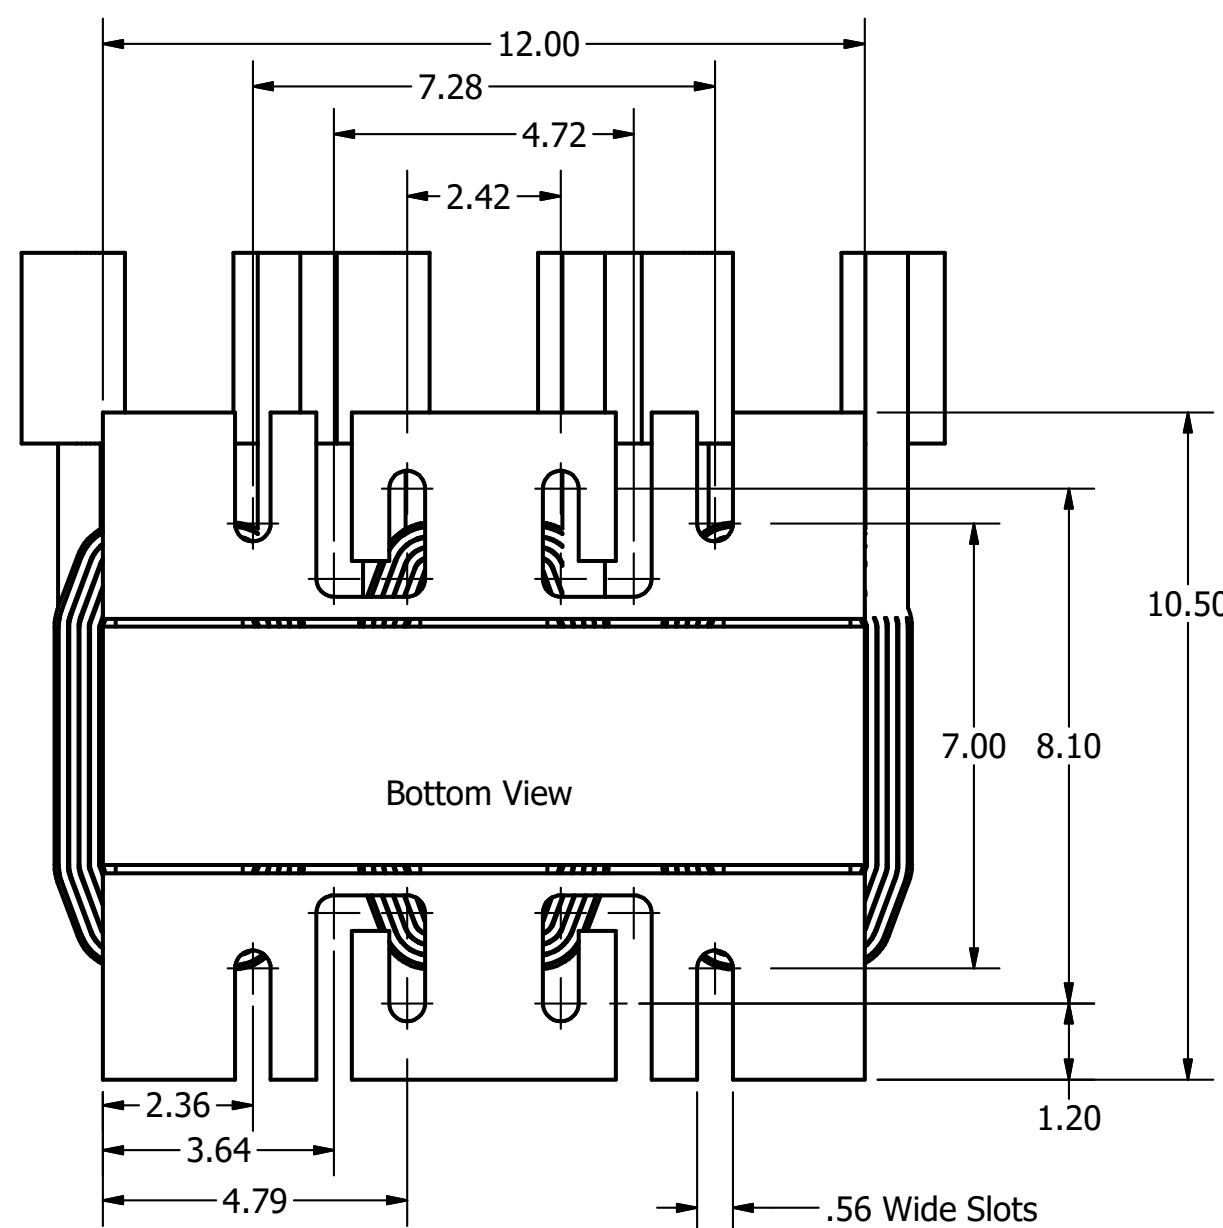\* For single phase applications, use coils A and C, Isolate terminals B1 and B2.

**TCI** (800) 824-8282 [transcoil.com](http://transcoil.com)

**KDRUL Drive Reactor**  
**KDR- Motor Amps**  
 3PH, 50/60Hz, —V Rated, 600V Max, —A Max  
 40C Amb Max, 15SC Rise, RoHS  
 Manual #30895 LUG KIT #SLK—

TCI, LLC  
 Germantown, WI, USA.  
[transcoil.com](http://transcoil.com)  
 800-824-8282

DATE CODE **A1** **B1** **C1**

UL LISTED CE

- Notes:
1. KDR Lug Kits sold separately. Contact TCI.
  2. For KDRUL Version With Terminal Lugs Attached, See Sheet 6
  3. UL file number: cULus Listed File E116124.
  4. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
  5. KDR IOM Manual Part Number 30895
  6. NEC Current For 208/240 Volts, Horsepower Based On 208 Volts.
  7. Material(s) Shall be RoHS Compliant
  8. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED)		W132 N10611 Grant Drive Germantown, WI 53022	
				DECIMAL		KDR S Frame, Copper Bus Reactor Drawing	
				XX ± .25		DRN BY DSW DATE: 3/2/18 107538DG	
				.XXX ± .10		SCALE: 1/3.2 APRVD: SIZE C SHT. 5 OF 8	
				FRACTIONAL ± 1/16			
A Combine Drawings				3/2/18	DSW		
NO REVISION				DATE	BY		