


480 Rated Voltage, 600 Max Voltage, High Z, Impedance.								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Available Lug Kit	Terminal Hole Size (Inches)
KDRX2H	800	960	965	32.5	305	1661	SLK16	0.53




480 Rated Voltage, 600 Max Voltage, Low Z, Impedance.								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Available Lug Kit	Terminal Hole Size (Inches)
KDRX2L	800	960	965	19.5	280	997	SLK16	0.53

575 Rated Voltage, 600 Max Voltage, High Z, Impedance.								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Available Lug Kit	Terminal Hole Size (Inches)
KDRX44H	800	768	864	49.8	310	1592	SLK16	0.53

575 Rated Voltage, 600 Max Voltage, Low Z, Impedance.								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Available Lug Kit	Terminal Hole Size (Inches)
KDRX41L	900	864	900	26.6	280	1075	SLK16	0.53
KDRX42L	1000	960	1000	23.9	280	1194	SLK16	0.53

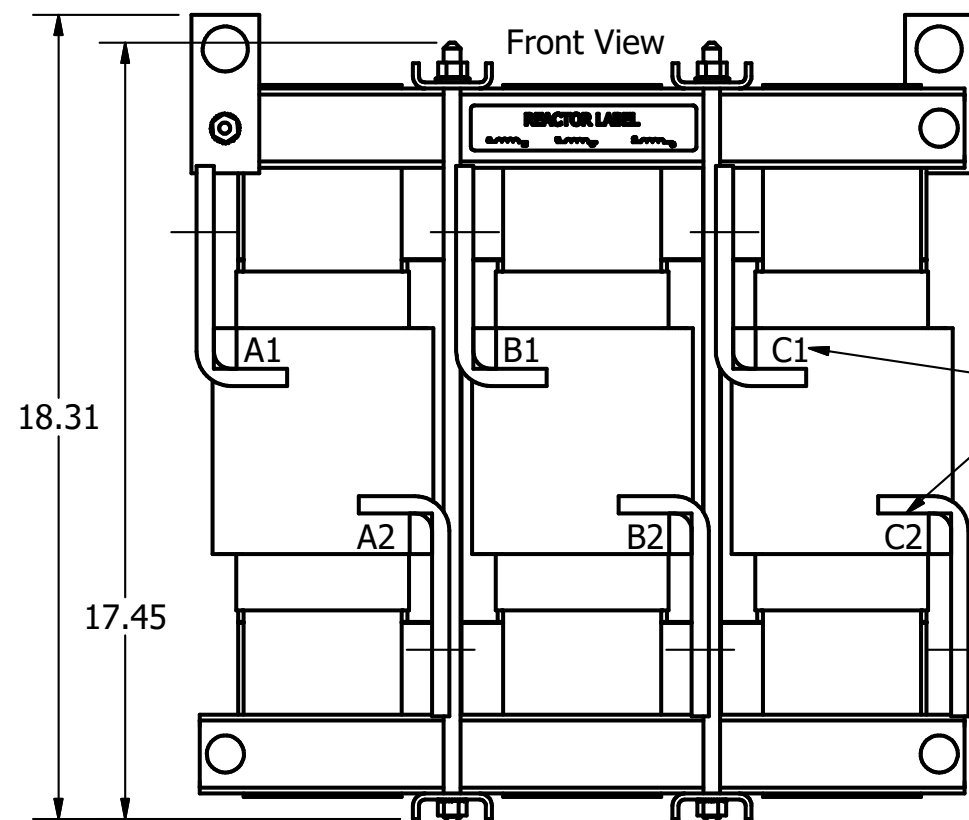

(Customer Connections) Markings On Coils For Reference Only.

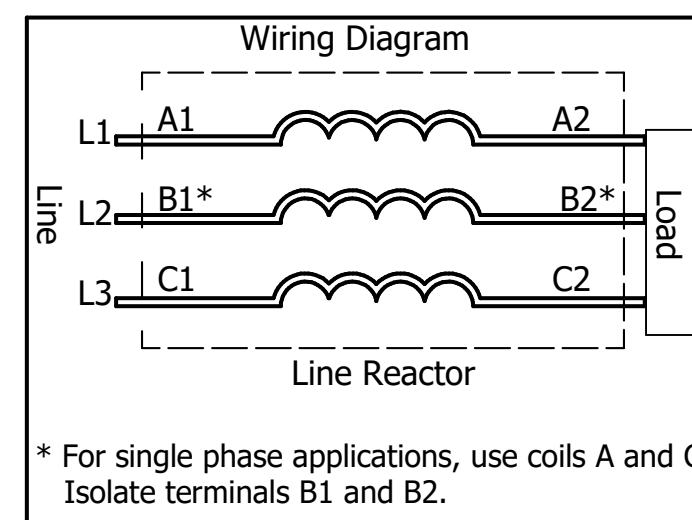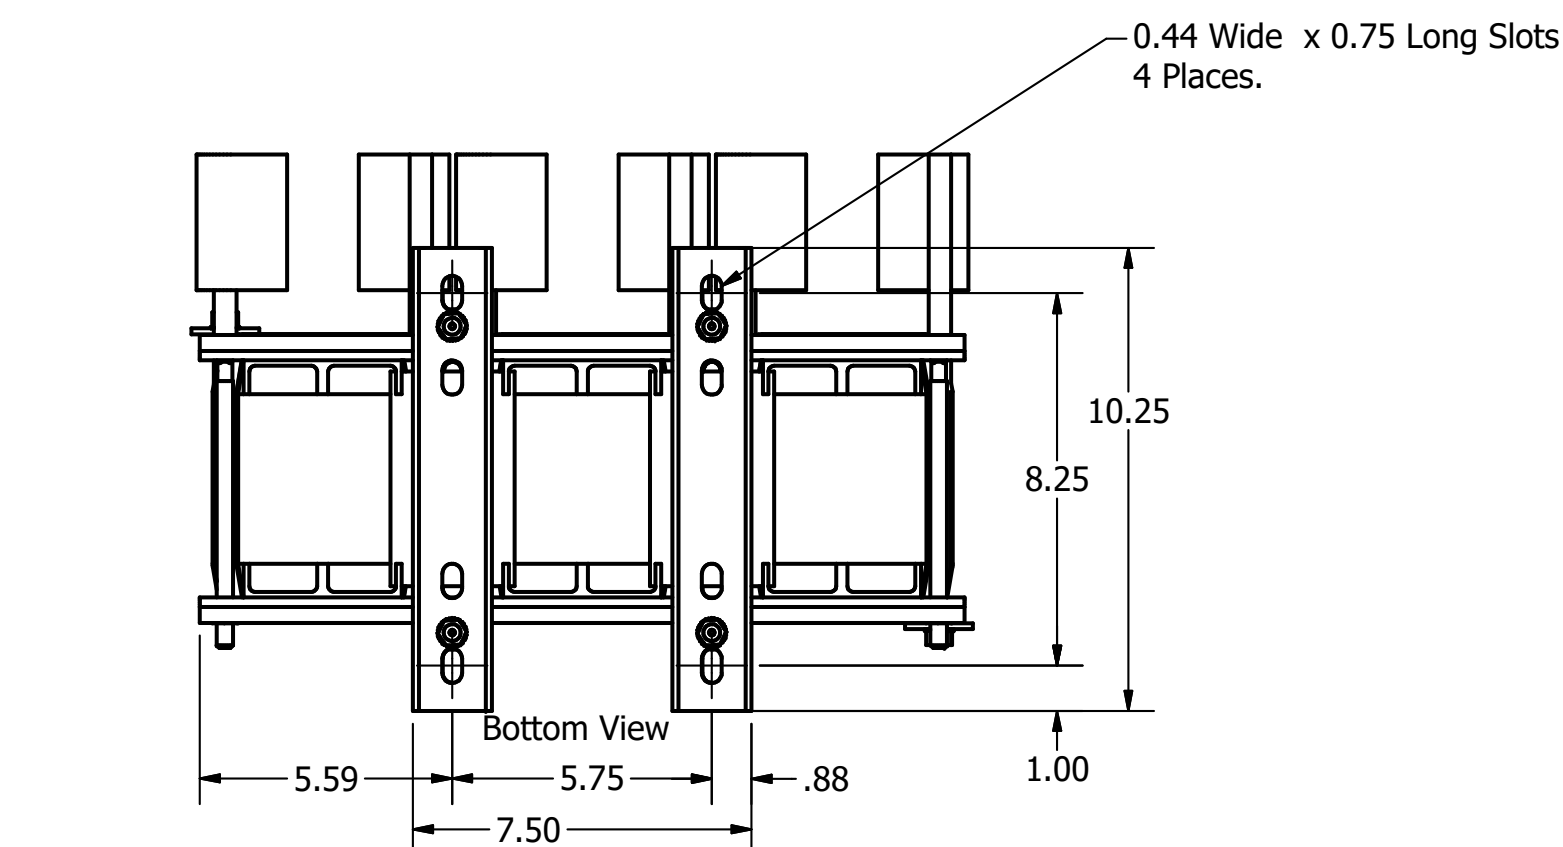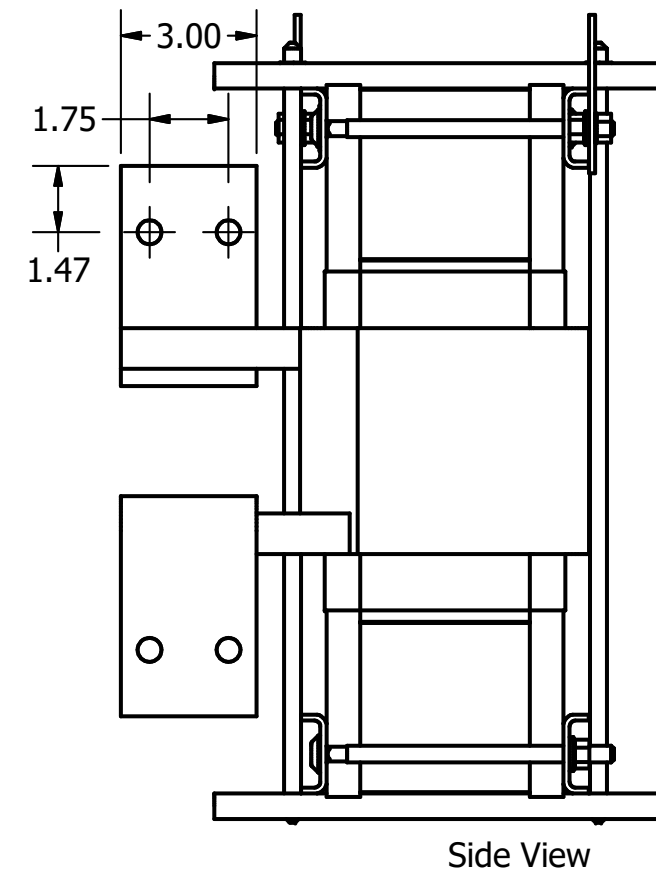

TCI (800) 824-8282 transcoil.com

TCI, LLC
Germantown, WI USA.
transcoil.com
800-824-8282

KDRUL Drive Reactor
KDR- Motor Amps -
3PH, 50/60Hz, -V Rated, 600V Max, -A Max
40C Amb Max, 155C Rise, RoHS
Manual #30895 LUG KIT #SLK-

UL LISTED CE
2ND CONT. IMP. CLASS

DATE CODE A1 B1 C1

Notes:

1. KDR Lug Kits sold separately. Contact TCI.
2. For KDRUL Version With Terminal Lugs Attached, See Sheet 2
3. UL file number: cULus Listed File E116124.
4. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
5. KDR IOM Manual Part Number 30895
6. NEC Current For 208/240 Volts, Horsepower Based On 208 Volts.
7. Material(s) Shall be RoHS Compliant
8. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.

TOLERANCES (EXCEPT AS NOTED)		
DECIMAL		
	XX ± .25	
	.XXX ± .10	
FRACTIONAL		
	± 1/16	
ANGULAR		
	± 1°	
A	Combined Drawings	3/5/18 DSW
NO	REVISION	DATE BY

TCI W132 N10611 Grant Drive
Germantown, WI 53022

KDR X Frame, Copper Bus
Reactor Drawing

DRN BY: DSW DATE: 3/5/18 107539DG
SCALE: 1/4.5 APRVD: SIZE: C SHT 1 OF 6